


TYPICAL CUL-DE-SAC
WATER PLAN

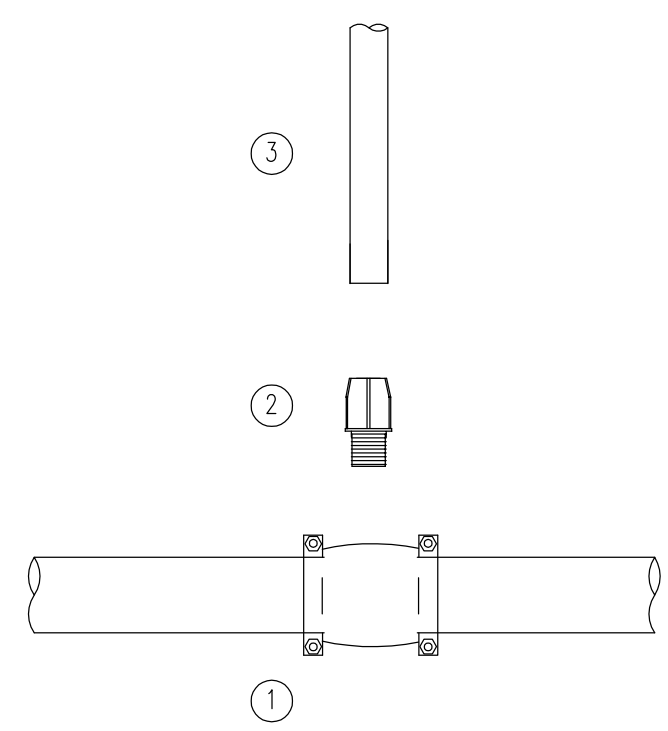

DETAIL A

MARK NO	DESCRIPTION
1	Elongated Tapping Band – Tapped to 50mmØ BSPT
2	50mmØ MI 63mmØ Poly End Connector
3	DN63 HDPE PN 12.5
4	100 Sluice Valve
5	100 Hydrant, Tee and Riser
6	End Cap and Thrust Block
7	100mm PVC Service Conduit

FITTINGS DETAIL

REVISIONS				APPROVED	RPEQ	DATE	DISCLAIMER. The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, of consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.	Capricorn Municipal Development Guidelines Incorporating: Rockhampton City Council Livingstone Shire Council Fitzroy Shire Council Mount Morgan Shire Council	LIVINGSTONE SHIRE COUNCIL CUL-DE-SAC SCOUR DETAILS Livingstone Shire Council	STANDARD			
										STANDARD DRAWING			
										SD-W-081-LSC			
										REV. A B			
B	LSC ALTERATIONS			D.T.	5424	8/3/06							
A	ORIGINAL ISSUE												