


**GENERAL NOTES**

IN ACCORDANCE WITH AS3500-1-2003 SECTION 4 BACK-FLOW PREVENTION DEVICES (i.e. R.P.Z. VALVES) ARE REQUIRED TO BE INSTALLED IN HIGH RISK AREAS TO PREVENT CONTAMINATION OF POTABLE WATER SUPPLY.

HIGH RISK AREAS ARE DEFINED IN SECTION 4 OF THE AUSTRALIAN STANDARD AND INCLUDE INDUSTRIAL, COMMERCIAL, AGRICULTURAL, HORTICULTURAL AND IRRIGATION APPLICATIONS.

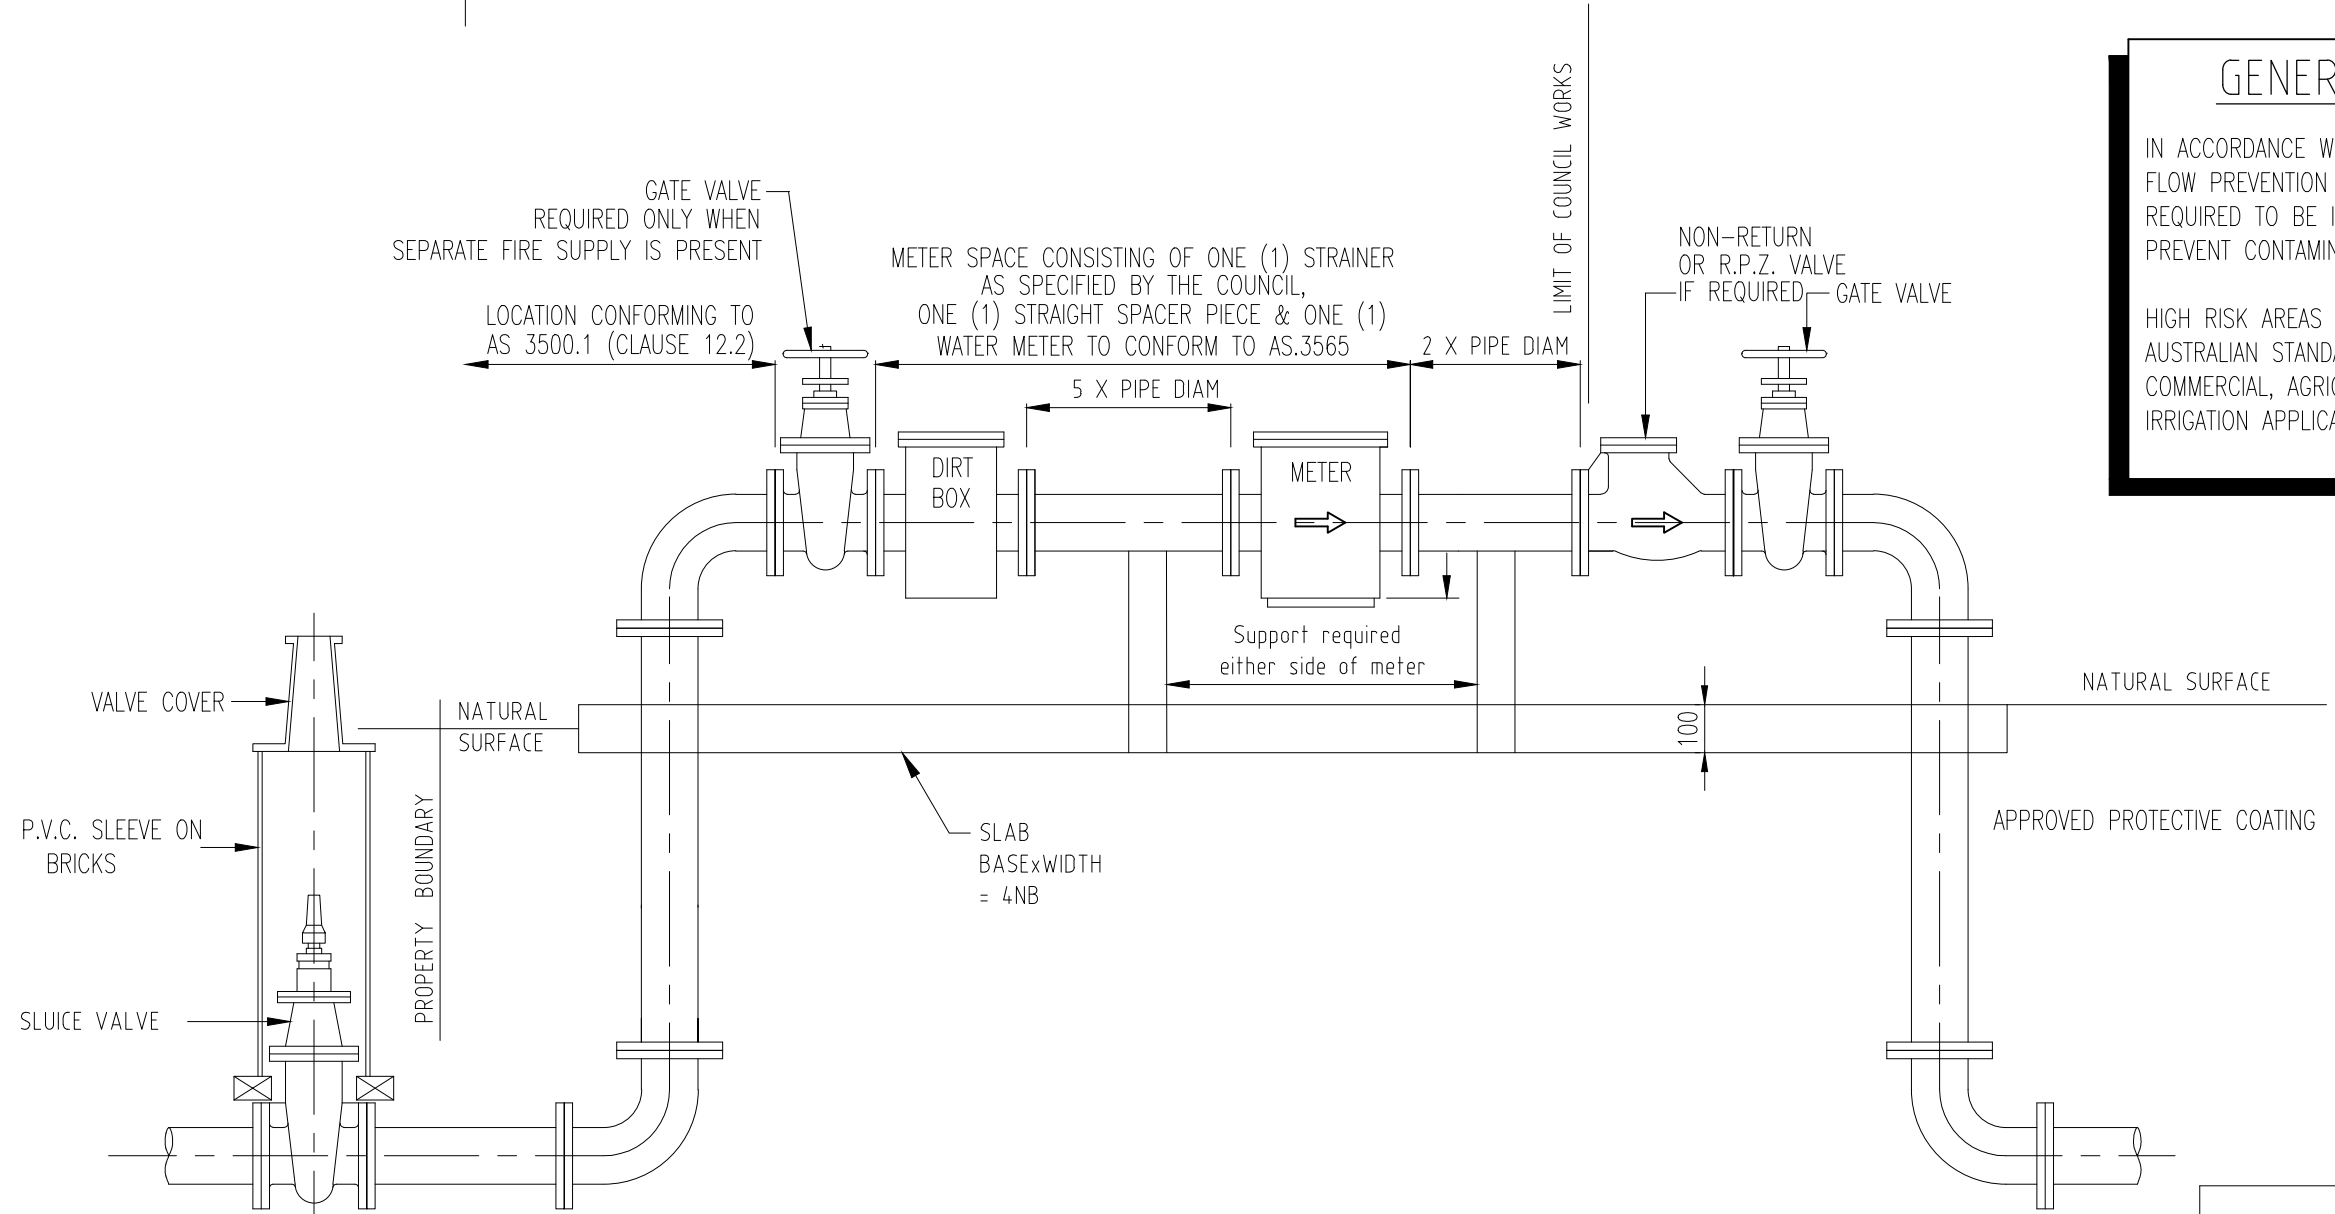

APPLICABILITY TABLE							
Council	BSC	CHRC	GRC	IRC	LSC	MRC	RRC
Applicable	Yes	No	No	Yes	Yes	Yes	Yes
Applicable DWG	W-094A or W094B						

REVISIONS	DATE
G IRC ADDED	11/2016
F AMEND RRC APPLICABILITY	03/2015
E GRC AND LSC ADDED	09/2014
D MRC APPLICABILITY - YES	03-04-13
C SLAB DETAILS INCLUDED	22-01-13
B RRC AMENDMENTS	24-05-11
A ORIGINAL ISSUE	01/2010

**DISCLAIMER.**

The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, of consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.

**Capricorn Municipal Development Guidelines**

Incorporating:

Banana Shire Council (BSC) Livingstone Shire Council (LSC)  
 Central Highlands Regional Council (CHRC) Maranoa Regional Council (MRC)  
 Gladstone Regional Council (GRC) Rockhampton Regional Council (RRC)  
 Isaac Regional Council (IRC)

**100 & 200MM  
WATER METER CONNECTIONS**

ROADS						
STANDARD DRAWING						
CMDG-W-094						
REV.	A	B	C	D	E	F
	G					