


PLAN VIEW
Scale NTS

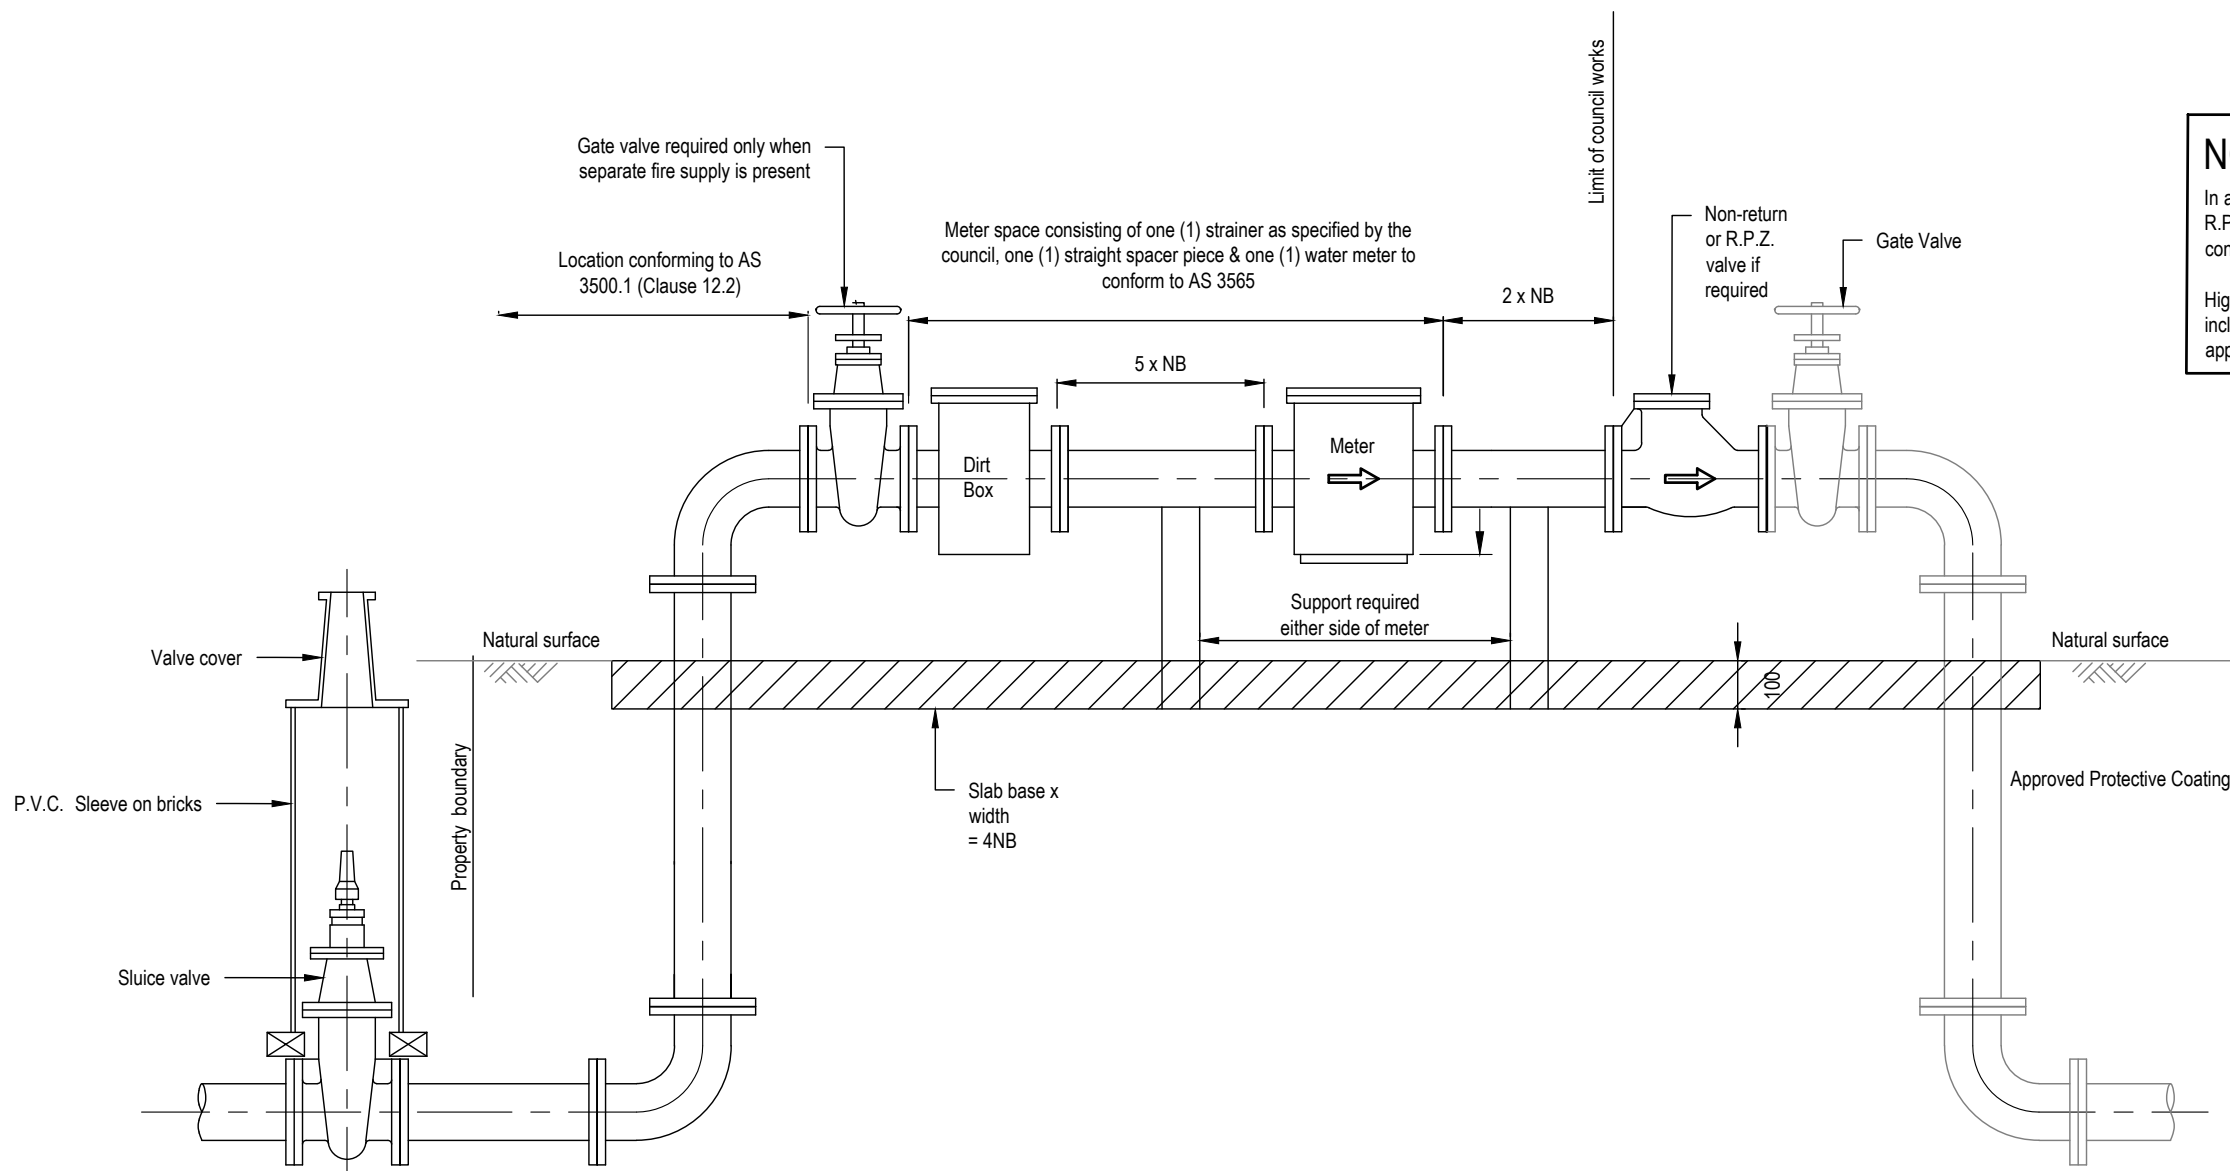

SECTION A
Scale NTS

NOTES

In accordance with AS 3500-1 Section 4 Back-Flow Prevention Device (i.e. R.P.Z. Valves) are required to be installed in high risk areas to prevent contamination of potable water supply.

High risk areas are defined in Section 4 of the Australian Standard and include industrial, commercial, agricultural, horticultural and irrigation applications.

APPLICABILITY TABLE							
Council	BSC	CHRC	GRC	IRC	LSC	MRC	RRC
Applicable	Yes	No	No	Yes	Yes	Yes	Yes
Applicable DWG	W-094A or W-094B						

REVISIONS	DATE
H INCLUDED 50 & 80MM WM DETAILS IN TBLK	05/2022
G IRC ADDED	11/2016
F AMEND RRC APPLICABILITY	03/2015
E GRC AND LSC ADDED	09/2014
D MRC APPLICABILITY - YES	04/2013
C SLAB DETAILS INCLUDED	01/2013

DISCLAIMER.
The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, of consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.

Capricorn Municipal Development Guidelines

Incorporating:

Banana Shire Council (BSC)	Maranoa Regional Council (MRC)
Central Highlands Regional Council (CHRC)	Rockhampton Regional Council (RRC)
Gladstone Regional Council (GRC)	Isaac Regional Council (IRC)
Livingstone Shire Council (LSC)	

**50, 80, 100, 150 & 200MM
WATER METER CONNECTIONS**

WATER	
STANDARD DRAWING	A3
CMDG-W-094	
REV.	C D E F G H