


PLAN VIEW
Scale NTS

NOTES

In accordance with AS3500-1 Section 4 Back- Flow Prevention Devices (i.e. R.P.Z. valves) are required to be installed in high risk areas to prevent contamination of potable water supply.

High risk areas are defined in Section 4 of the Australian Standard and include industrial, commercial, agricultural, horticultural and irrigation applications.

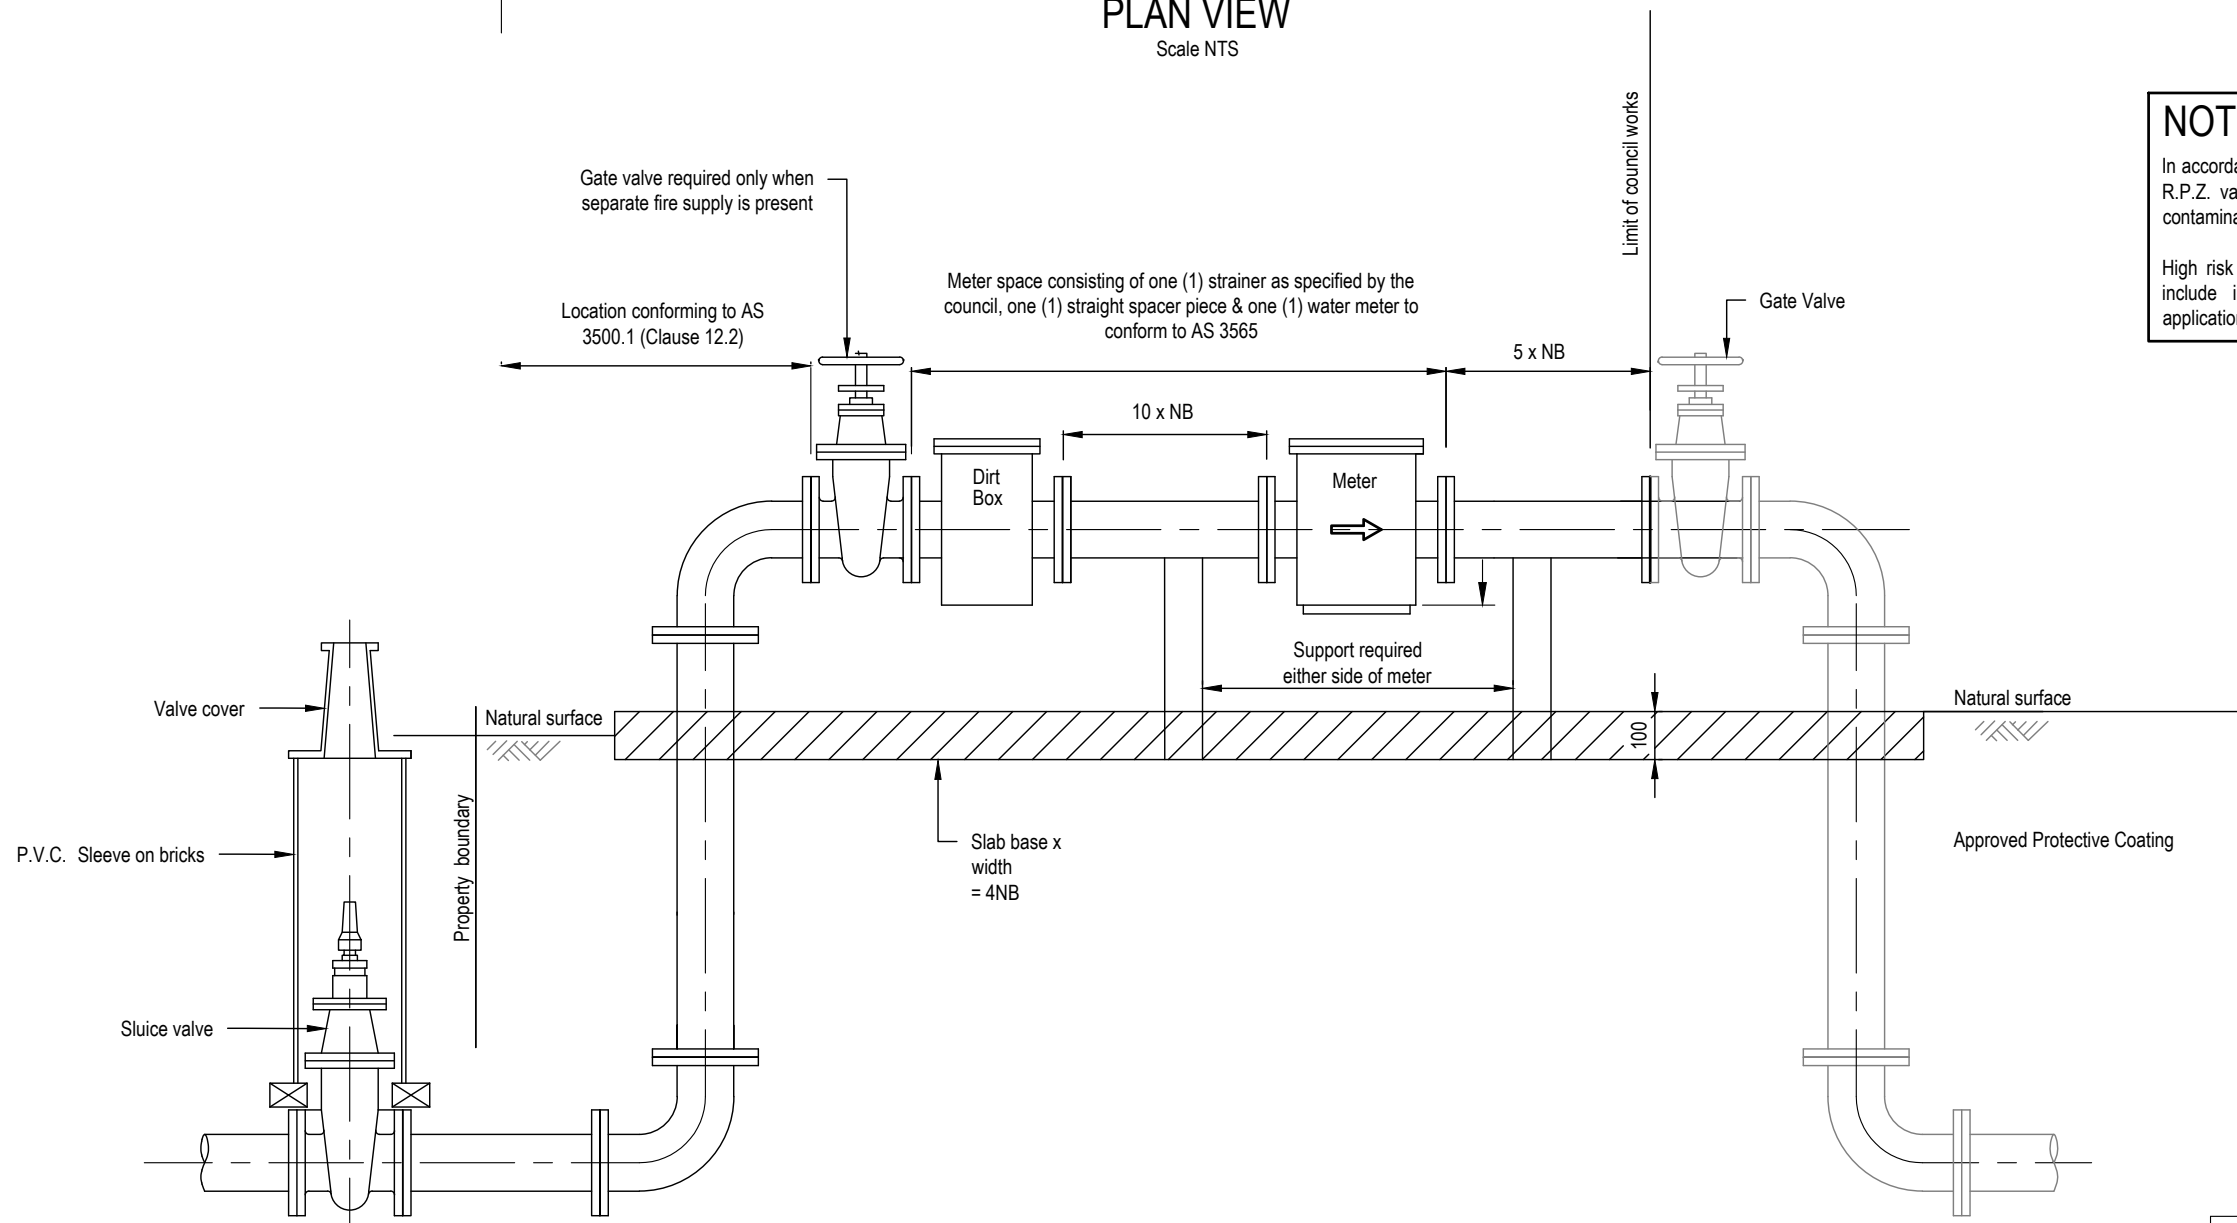

SECTION A
Scale NTS

| APPLICABILITY TABLE | | | | | | | |
|---------------------|-----------------|------|-----|-----|-----|-----|-----|
| Council | BSC | CHRC | GRC | IRC | LSC | MRC | RRC |
| Applicable | No | No | Yes | No | No | No | No |
| Applicable DWG | W-094 or W-094A | | | | | | |

| REVISIONS | DATE |
|-----------|---------|
| C | 05/2022 |
| B | 11/2016 |
| A | 03/2015 |

DISCLAIMER.
The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, of consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.

Capricorn Municipal Development Guidelines
Incorporating:
Banana Shire Council (BSC) Maranoa Regional Council (MRC)
Central Highlands Regional Council (CHRC) Rockhampton Regional Council (RRC)
Gladstone Regional Council (GRC) Isaac Regional Council (IRC)
Livingstone Shire Council (LSC)

**50, 80, 100, 150 & 200mm
WATER METER CONNECTIONS**

| ROADS | |
|--------------------|-----------|
| STANDARD DRAWING | A3 |
| CMDG-W-094B | |
| REV. | A B C |